


S.No.	DESCRIPTION	QTY	MATL
1	H.T TERMINAL 12 mm THREADED	1	BRASS
2	MAIN INSULATION	-	PAPER
3	BUSHING CLAMP	1	M.S
4	BUSHING	1	HV PORCELAIN
5	LIFTING LUG	2	M.S
6	CORE	-	CRGO
7	TANK WITH COVER	1	M.S
8	OIL DRAIN PLUG	1	M.S
9	EARTHING TERMINAL	2	M.S
10	SECONDARY TERMINAL BOX	1	M.S
11	OIL FILLING PLUG	1	M.S
12	LT WINDING	-	COPPER
13	MOUNTING HOLES $\phi 17$	4	M.S
14	EARTHING TERMINAL BOX	1	M.S


NOTE :-


1. Make of Bushing : IEC/WSI/CJI

ALL FERROUS PARTS EXPOSED TO THE ATMOSPHERE SHALL BE HOT DIP GALVANISED AND THEN EPOXY PAINTED HAVING LIGHT GREY CONFIRMING TO SHADE 631 OF ISS

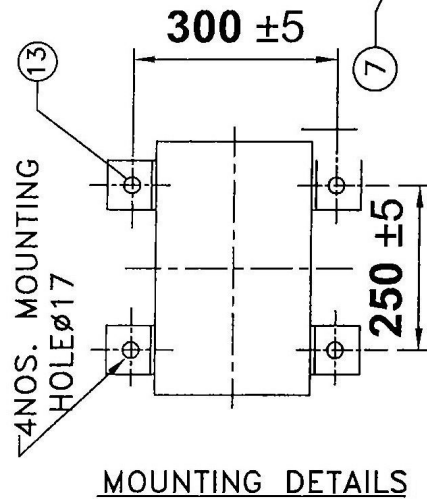

CREEPAGE DISTANCE 900mm MIN
OIL QUANTITY 20 LITRES APPROX.
TOTAL WEIGHT 75 KG APPROX.

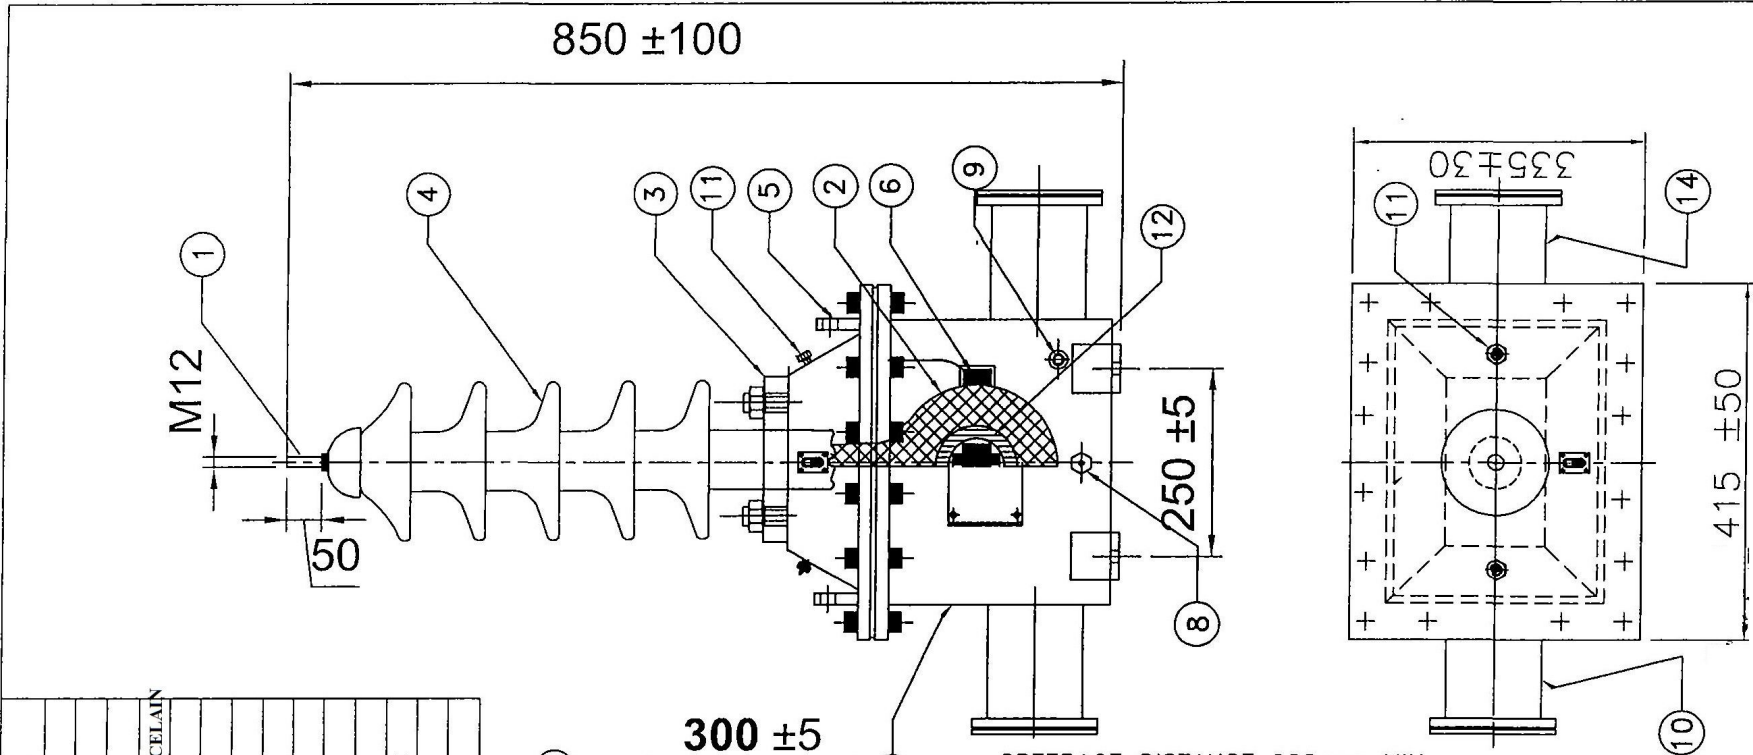

CUSTOMER	 BIHAR STATE POWER TRANSMISSION CO. LTD		
THE DRAWING IS THE PROPERTY OF M/S TECHNICAL ELECTRIC & ENGINEERING CO. LTD. AND NOT TO BE COPIED OR USED WITHOUT THEIR PRIOR PERMISSION			
SUPPLY LOI NO.			
ERECTION LOI NO.			
PROJECT			
SUBSTATION			
VENDORS NAME			
DRG. TITLE	SECTIONAL ARRANGEMENT OF 33 KV PT		
DRG. NO.	33-KV-PT-SA		
SCALE:	NTS	JOB NO:	SHEET