



BAR BENDING SCHEDULE FOR FOUNDATION						
MARK No.	SHAPE OF THE BAR	DIA (mm)	LENGHT (mm)	Nos. Leg	Unit Wt. (kg/m)	Wt./Leg. (kg)
A		10	3000	62	0.617	114.762
B		10	2040	18	0.617	22.656
C		10	3224	20	0.617	39.784
D		25	3350	8	3.854	103.287
E		8	1590	13	0.390	8.061
F		8	1198	13	0.390	6.074
TOTAL REINFORCEMENT						24.215

TYPE OF TOWER : DC+0

TOWER SLOPE TAN ALPHA = 0.152107

LEVEL	STUB	CG OF STUB	P	M	N	CLEAT DETAILS
+0M	HT110*110*10	30.9	6613	7333	10370	MS 90*90*6 NO. OF PAIRS 2 4 BOLTS/PAIR

QUANTITIES/TOWER	
EXCAVATION VOLUME	= 138.72 Cu.M
CONCRETE (1:1.5:3)	= 13.715 Cu.M
CONCRETE (1:3:6)	= 1.922 Cu.M
REINFORCEMENT	= 1178.501 Kgs.

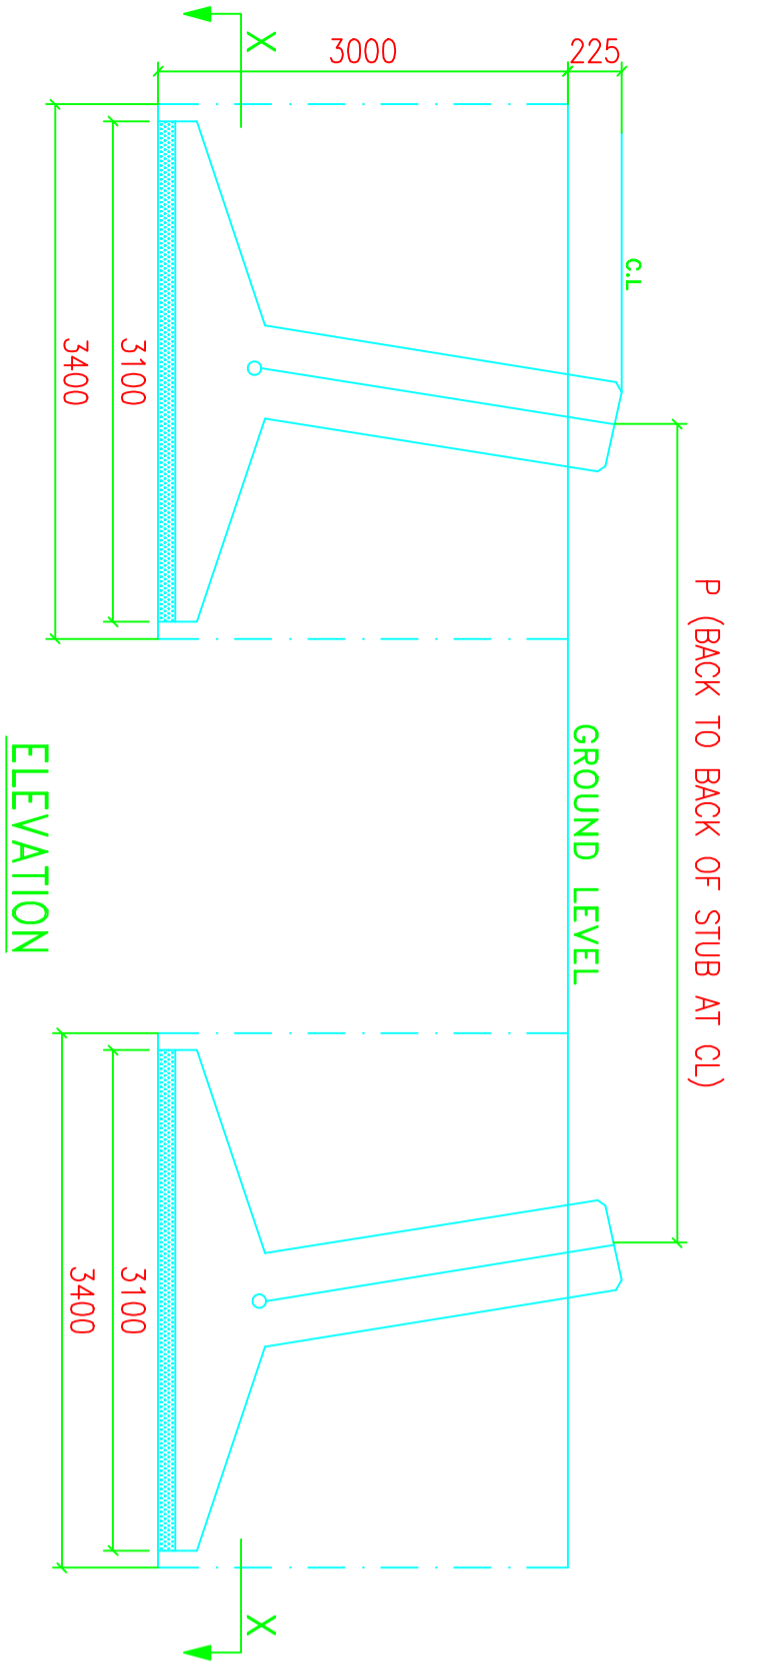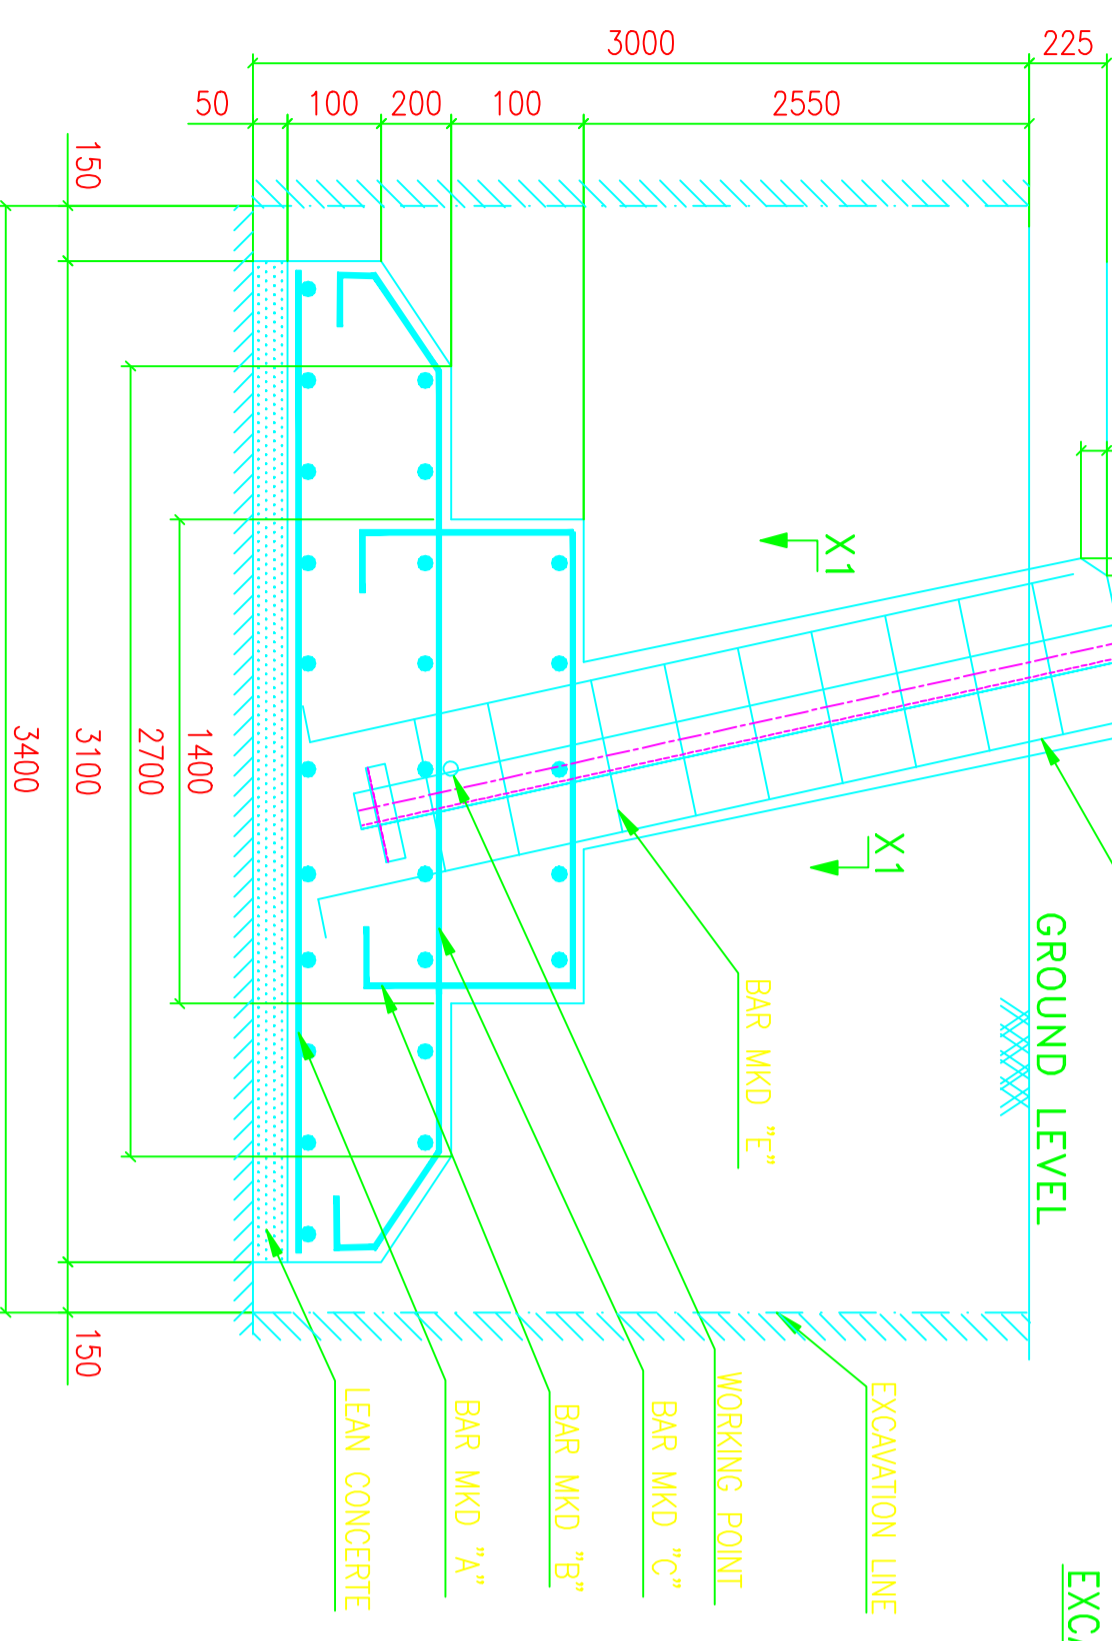

- NOTES:-**
- DRAWING NOT TO SCALE.
 - ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE STATED.
 - REINFORCED BAR USED Fe 415 CONFORMING TO IS 1786-1985
 - MIX PROPERTIES CONFORMING TO IS 456-2000
 - CONCRETE MIX USED GRADE M-20 (NOMINAL MIX 1:1.5:3)
 - LEAN CONCRETE MIX USED GRADE M-10 (NOMINAL MIX 1:3:6)
 - WHENEVER NECESSARY TO CLEAR STUB AND CLEAT STIRRUPS AND BARS ARE TO BE ADJUSTED AT SITE.
 - CLEAR COVER TO THE MAIN REINFORCEMENT BARS SHALL BE 50MM UNLESS OTHERWISE SPECIFIED.
 - FOR CLEAT AND STUB TEMPLATE DETAILS PLEASE REFER RESPECTIVE STUB DRG.

THE FOUNDATION HAS BEEN DESIGNED FOR THE FOLLOWING PARAMETERS:

TYPE OF SOIL : WET
 UNIT WEIGHT : 1440/940 Kg/Cu.M
 BEARING CAPACITY : 13675 Kg/Sq.M
 ANGLE OF REPOSE : 30/15 Degrees
 WATER TABLE : 1.5M TO 3.0M BELOW G.L

DRAWN BY		DESCRIPTION	132KV D/C "DC+0" TOWER	SCALE	
CHECKED BY		FOUNDATION DRAWING OF TYPE - WET			
APPROVED BY		DRG NO	132KV-D/C-0-Fdn-Wet-32	SHEET NO	1-1
				REV.	0

BIHAR STATE POWER TRANSMISSION COMPANY LTD